

# WATER WELL AND SURFACE WATER SAMPLE RESULTS - VILLAGE OF MCCULLOM LAKE MAY 2010

- Water samples collected by McHenry County Dept. of Health Staff from 15 different locations:

1 Non-Community Public Water Supply  
1 Surface Water Sample  
13 Private Water Wells

- Sample Dates:


May 17 & May 19, 2010

- Analyzed by Independent Certified Private Laboratory

- Tested for 24 Volatile Organic Compounds (VOC's.) VOC's are synthetic chemicals containing carbon that evaporate easily at room temperature (i.e. benzene, formaldehyde, etc.)

## SAMPLE RESULTS – 2010

**• NO DETECTIONS OF VOLATILE ORGANIC COMPOUNDS AT ANY OF THE 15 LOCATIONS**

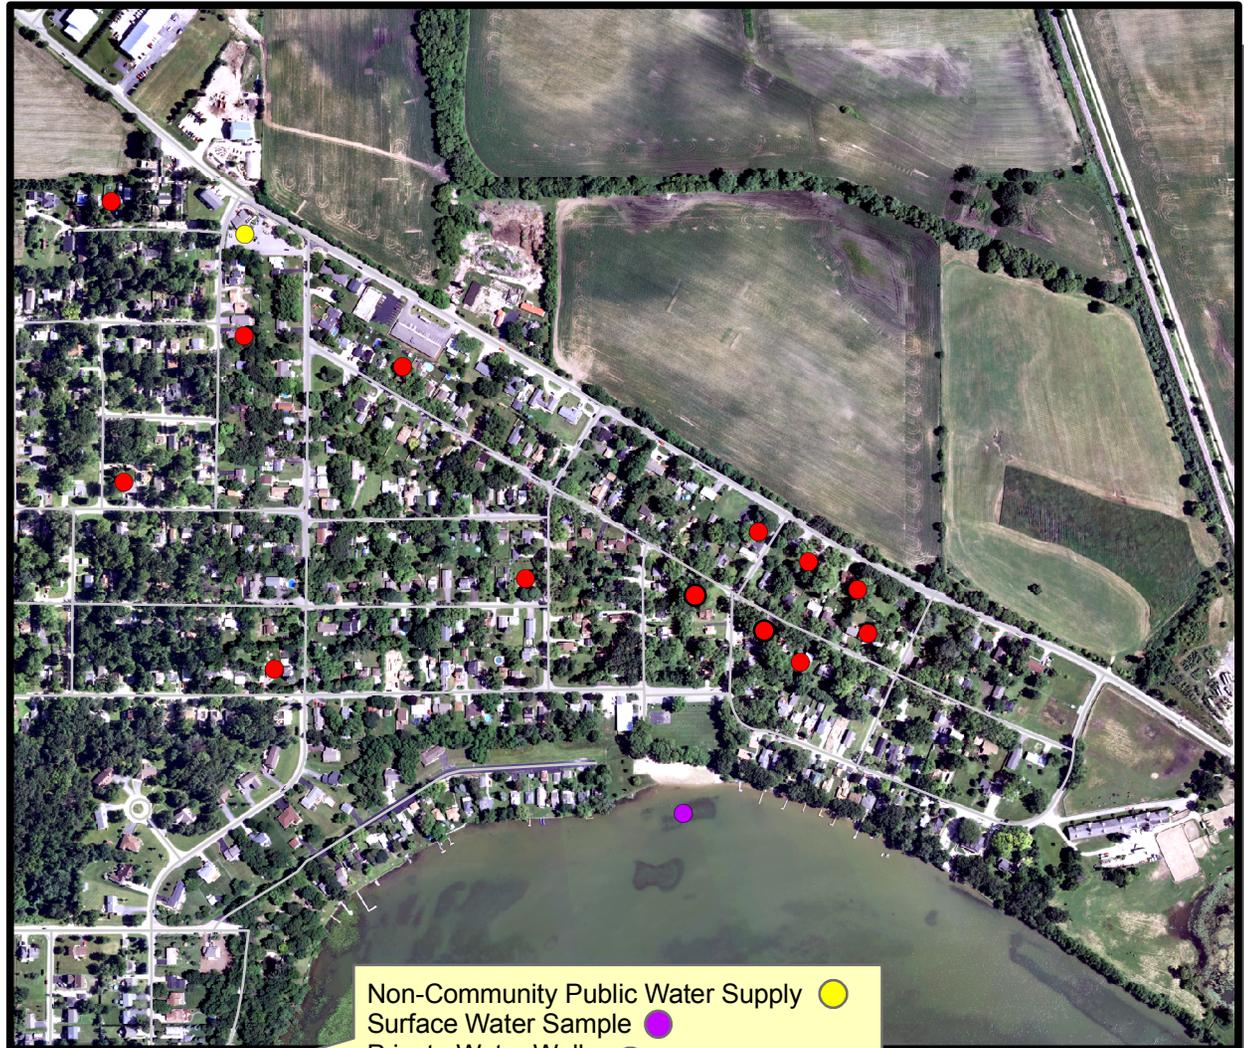

Non-Community Public Water Supply ●  
Surface Water Sample ●  
Private Water Wells ●