


WATER WELL SAMPLE RESULTS – CHLORIDES

Port Barrington

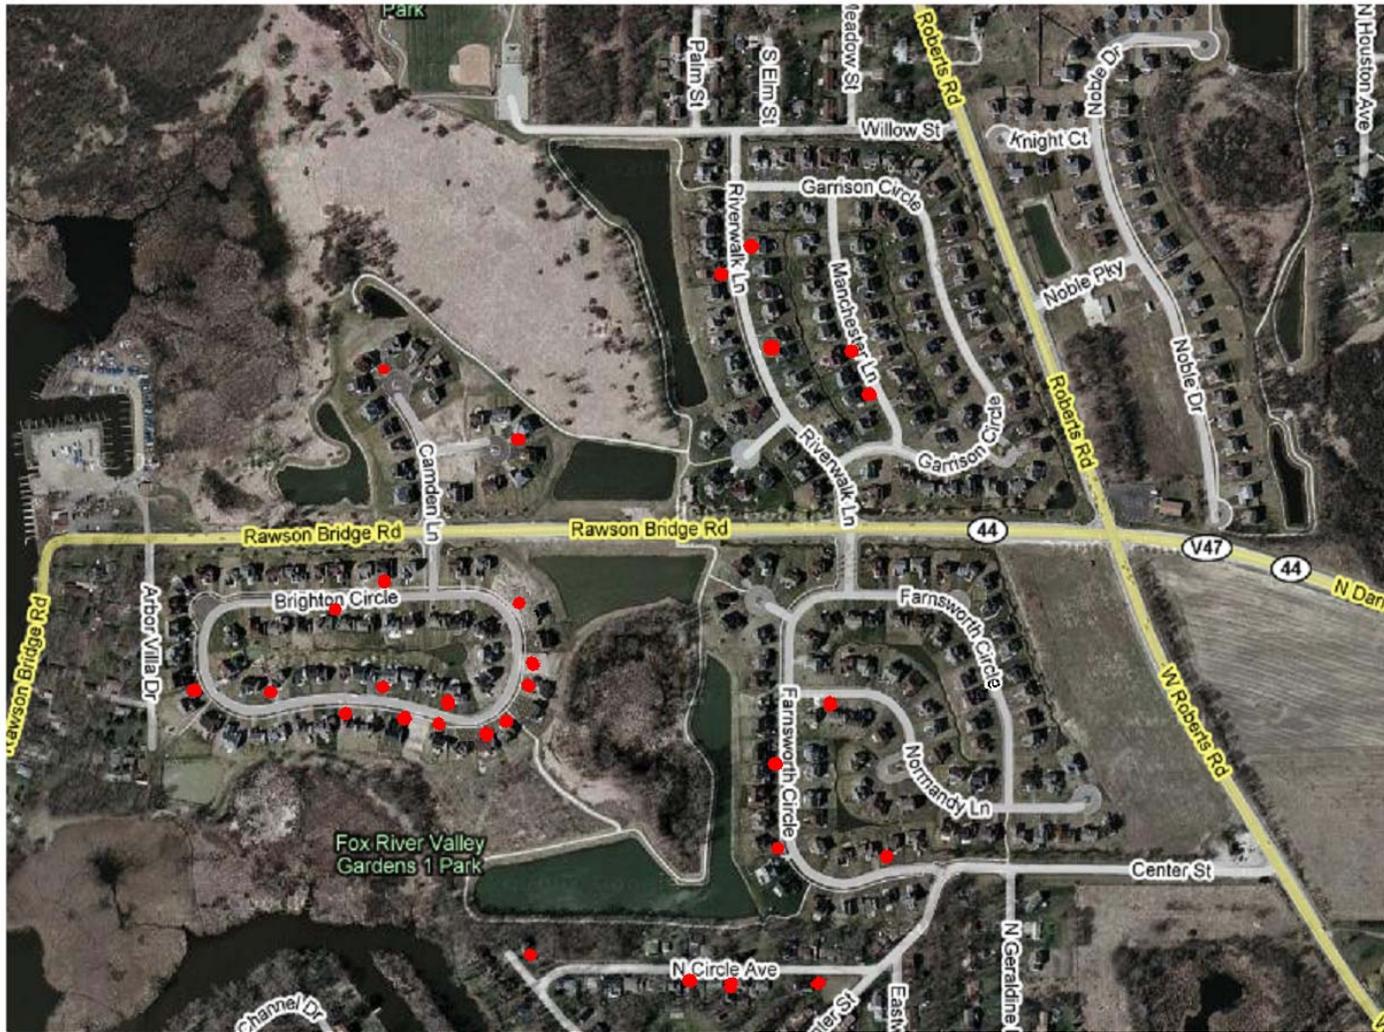

Water well samples collected by McHenry County Health Dept. Staff

Sample dates:

- Dec. 7, 2007
- Dec. 10, 2007
- Dec. 18, 2007
- Dec. 19, 2007
- Jan. 2, 2008
- Jan. 3, 2008
- Jan. 7, 2008

SAMPLE RESULTS

CHLORIDES

29 Samples Analyzed

Sample results range from 7.18 mg/L to 205.50 mg/L

The US Environmental Protection Agency (USEPA) recommended standard for Chloride in drinking water is less than 200 mg/L.

Water Well Sample Locations ●

Water samples were analyzed by McHenry County Dept. of Health.