


WATER WELL SAMPLE RESULTS – COPPER

Port Barrington

Water well samples collected by McHenry & Lake County Health Dept. Staff

Sample dates:

Nov. 27, 2007
 Nov. 28, 2007
 Nov. 29, 2007
 Dec. 10, 2007
 Dec. 18, 2007
 Dec. 19, 2007
 Jan. 2, 2008

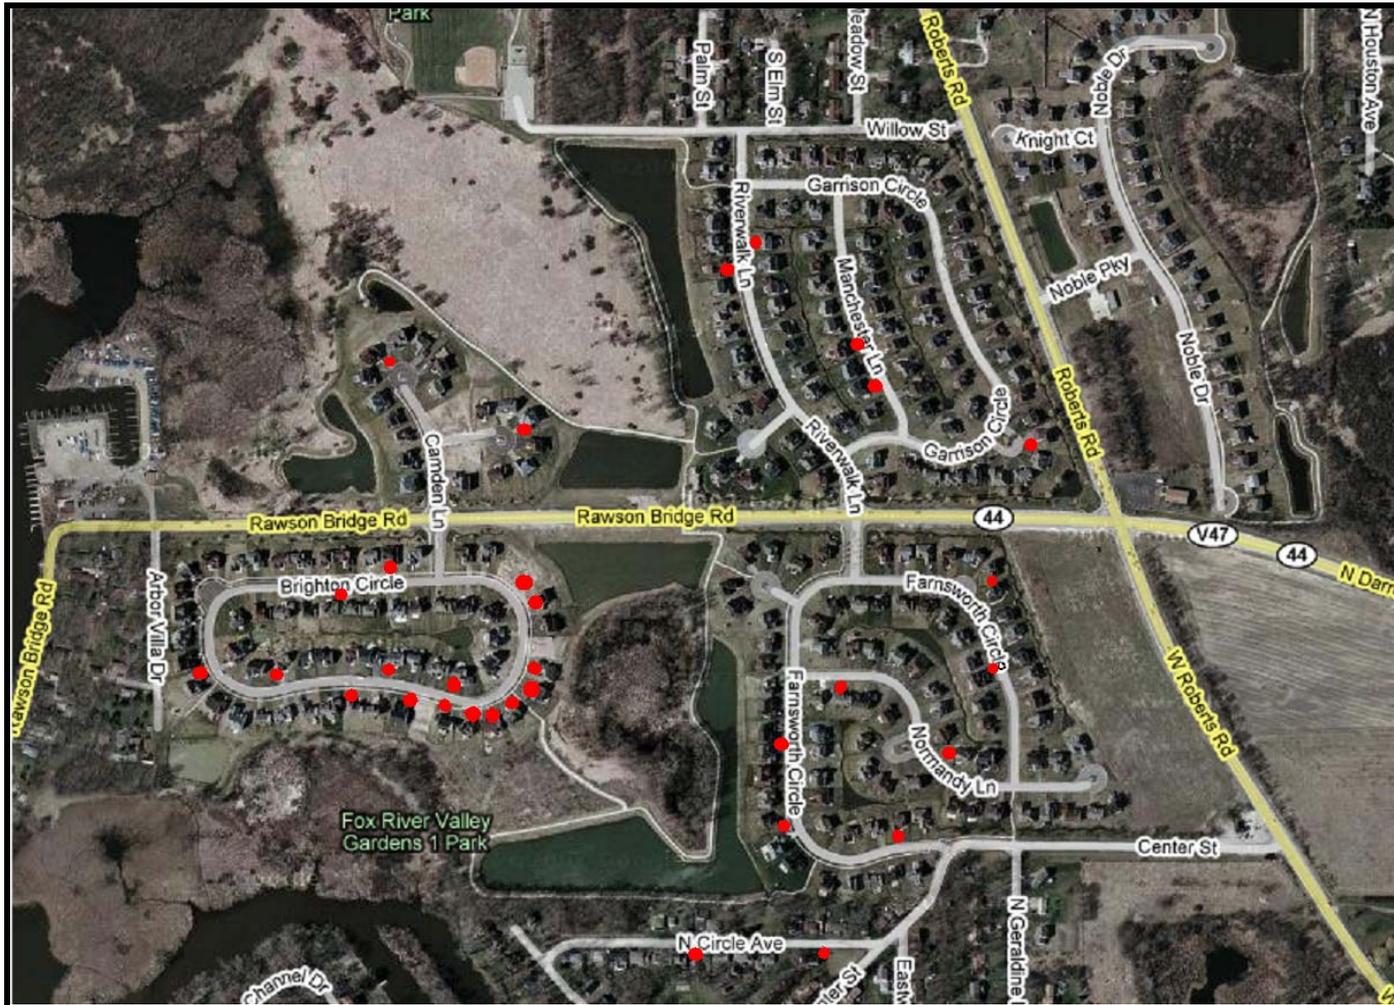

SAMPLE RESULTS

COPPER
 32 Samples Analyzed

29 Samples – No detection
 3 Samples – Detections of
 0.362mg/L, 0.106mg/L,
 0.150mg/L *

* Maximum Contaminate Level (MCL)
 Standard established by the US
 Environmental Protection Agency
 (USEPA)- less than 1.3mg/L

Water Well Sample Locations - ●

Water samples were analyzed by Lake County Health Dept. and Test America