

# WATER WELL SAMPLE RESULTS – NITRATES

## Port Barrington

Water well samples collected by McHenry & Lake County Health Dept. Staff


### Sample dates:

Dec. 7, 2007  
Dec. 10, 2007  
Dec. 18, 2007  
Dec. 19, 2007

## SAMPLE RESULTS

### NITRATES

26 Samples Analyzed -  
All samples < 1 mg/L  
(Maximum Contamination Level (MCL) Standard < 10 mg/L)

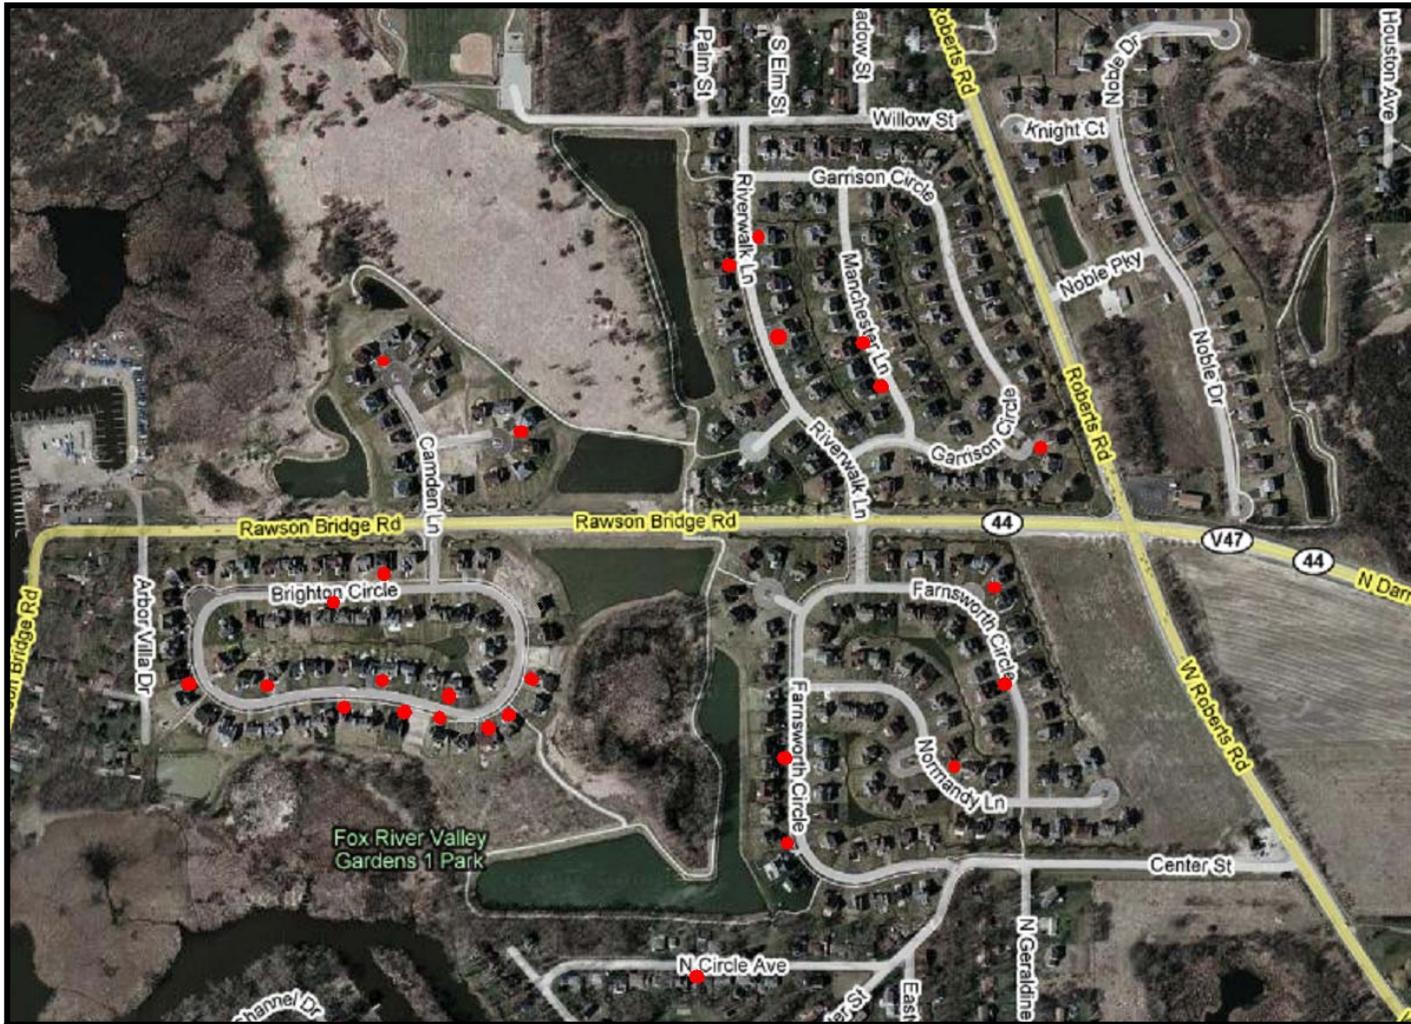

Water Well Sample Locations - ●

Water samples were analyzed by Lake County Health Dept. and McHenry County Dept. of Health.