Sample Results/Locations
Naturally Occurring Arsenic in McHenry County

Maximum Contamination Level (MCL)
for Arsenic in
Public Drinking Water Supplies
set at 10 parts per billion (ppb) by
US Environmental Protection Agency

WATER WELL SAMPLING RESULTS

Arsenic Levels in Parts Per Billion (ppb)

- *Not Detected*
- *0.01 to 10 ppb*
- *Greater than 10 ppb*

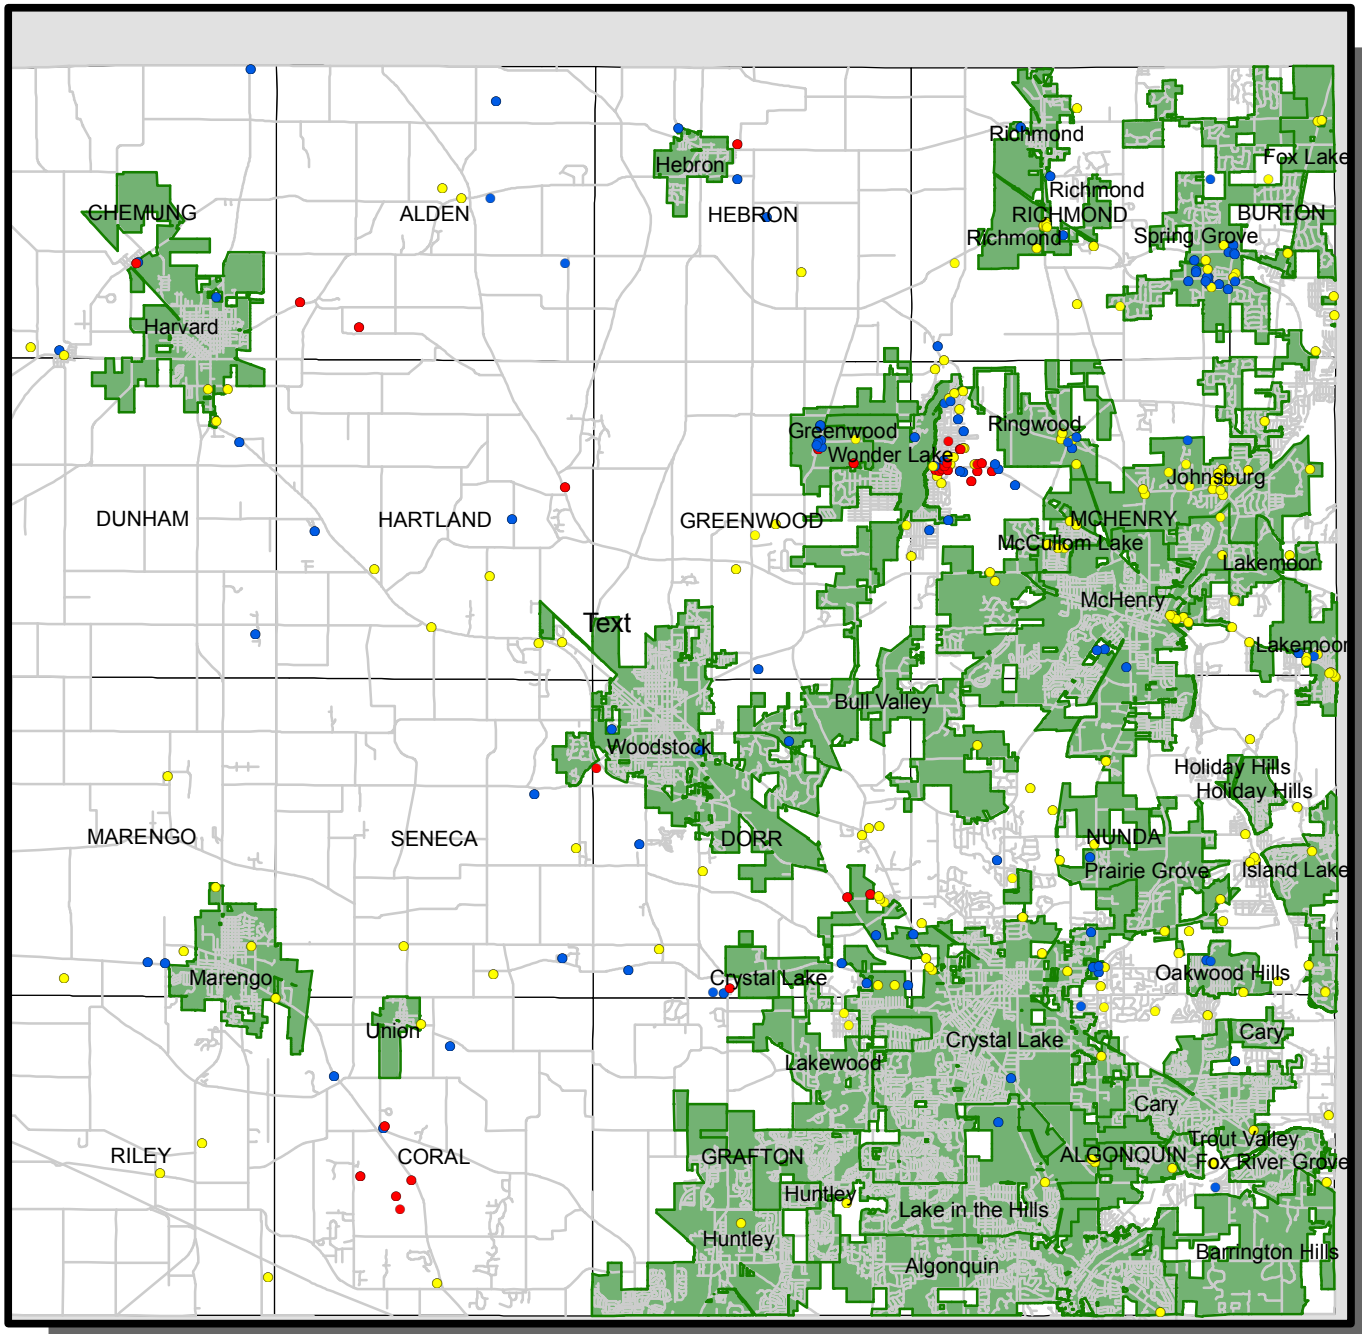

Water Samples Collected by
McHenry County Department of Health Staff
Samples analyzed by
IEPA Certified Private Labs
or The Illinois State Water Survey Laboratory

MAP UPDATED 11/30/2009